

Castle Cable & Citizens Telephone Co.
Installation & Regulations for Conduit

Schedule 40 PVC Conduit

***1)Size-“minimum 1”**

(Must be conduit, black water pipe not allowed)

Wide radius 90 degree “L”s or sweeps ***2)(not elbows)** are required on each end (pole and house).

A pull string of suitable strength is required to be installed in the conduit.


Customer is responsible for trenching, furnishing and installing the conduit.

Conduit should be buried at a recommended 3’ below ground level.

Customer is responsible for contacting the State/County for their regulations if installing on a public Right of Way.

Pole and house end should be a minimum of 3’ above ground level.

Both ends of the conduit must be plugged to prevent water or debris from entering prior to the installation of cable.

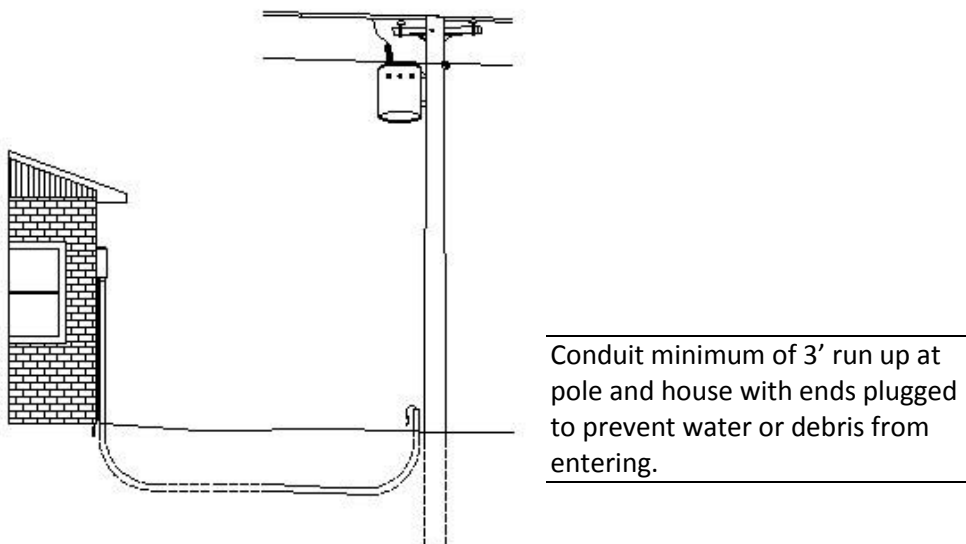

***1. We WILL NOT place cable in conduit smaller than 1”.**

***2. We WILL NOT place cable in conduits with 90 Deg. Elbows.**